


Symbol	Tag	Qty	Label	Arrangement	Total Lamp Lumens	LLF	Description
○	AB4 T3	6	UR20-56L-140-3K7-3-PT_1	Single	N.A.	0.750	UR20-56L-140-3K7-3-PT
○	AC1 T5R	5	UR28-96L-155-3K7-5R-PT	Single	N.A.	0.750	UR28-96L-155-3K7-5R-PT
○	AB2 T3	6	UR20-24L-65-3K7-3-PT	Single	N.A.	0.750	UR20-24L-65-3K7-3-PT
○	AB3 T3-BC	6	UR20-56L-75-3K7-3-BC-PT	Single	N.A.	0.750	UR20-56L-75-3K7-3-BC-PT
○	AA1 T5R	6	UR20-24L-25-3K7-5R-PT_1	Single	N.A.	0.750	UR20-24L-25-3K7-5R-PT
○	AB4 T3	3	UR20-56L-140-3K7-3-PT	Single	N.A.	0.750	UR20-56L-140-3K7-3-PT

LPD Area Summary			
Label	Area	Total Watts	LPD

Label	CalcType	Units	Avg	Max	Min
Calculation Summary					
Bus Drive Aisle	Illuminance	Fc	1.91	3.9	0.6
Bus Parking	Illuminance	Fc	1.12	3.3	0.1
Crosswalk-East	Illuminance	Fc	1.33	1.5	1.1
Crosswalk-East_1	Illuminance	Fc	1.70	2.3	1.0
Crosswalk-East_2	Illuminance	Fc	1.94	2.2	1.5
Curved Walkways East roadway	Illuminance	Fc	1.49	2.9	0.4
North Adjacent PMP	Illuminance	Fc	0.04	1.26	0.00
North Staff Lot Walkway	Illuminance	Fc	0.83	1.6	0.5
STAFF PARKING LOT	Illuminance	Fc	1.01	2.0	0.0
Van Drive Aisle	Illuminance	Fc	1.01	2.3	0.0
Van Parking	Illuminance	Fc	0.64	2.58	0.0
Walkways @ Facility East	Illuminance	Fc	1.48	2.9	0.4
Walkways East roadway	Illuminance	Fc	1.33	1.5	1.1
Walkways East roadway_1	Illuminance	Fc	1.70	2.3	1.0
Walkways East roadway_2	Illuminance	Fc	1.94	2.2	1.5
West Adjacent Properties	Illuminance	Fc	0.04	1.25	0.00

EXHIBIT E

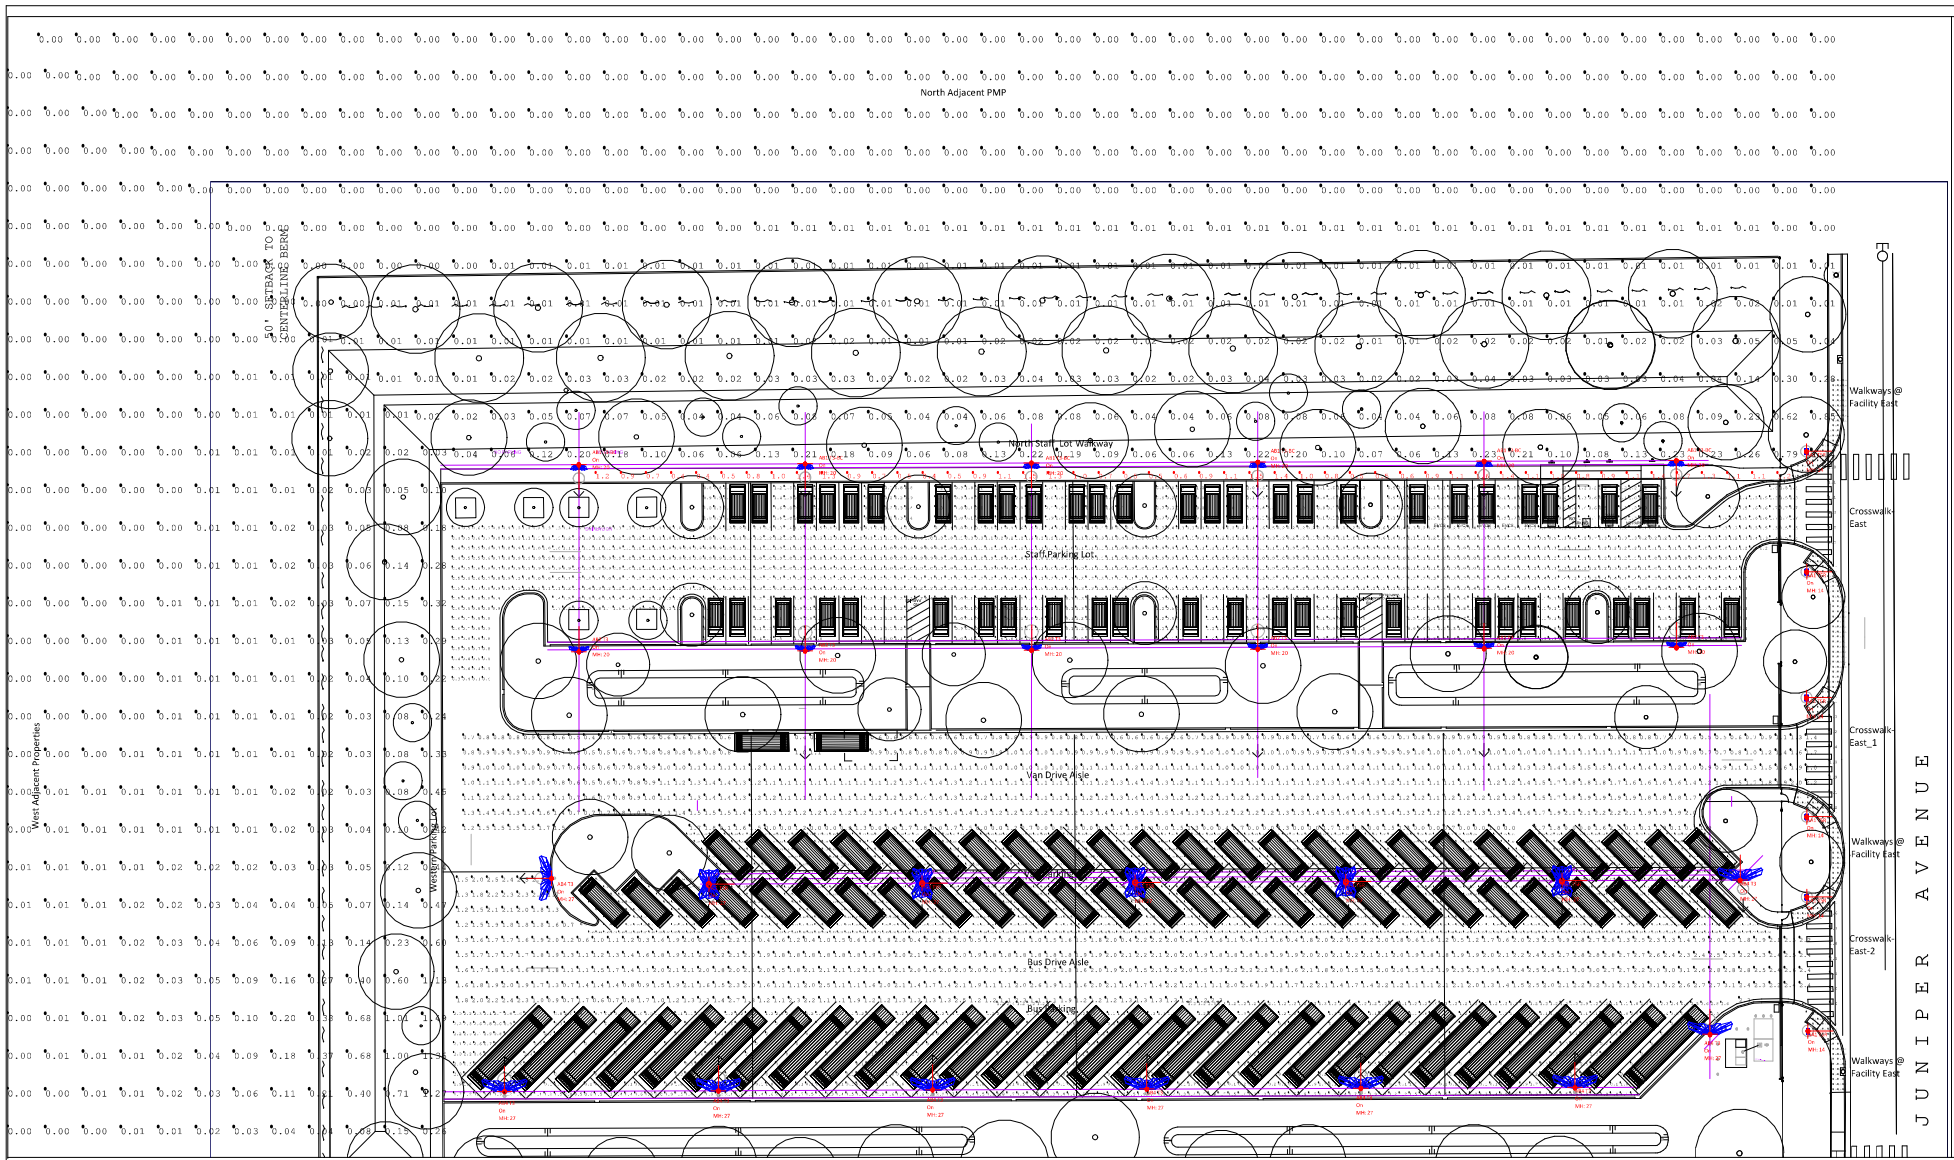

Symbol	Tag	Qty	Label	Arrangement	Total Lamp Lumens	LLF	Description
○	AB2 T3	6	UR20-24L-65-3K7-3-PT	Single	N.A.	0.750	UR20-24L-65-3K7-3-PT
○	AB1 T3-BC	6	UR20-56L-75-3K7-3-BC-PT	Single	N.A.	0.750	UR20-56L-75-3K7-3-BC-PT
○	AC1 T5R	5	UR28-96L-155-3K7-5R-PT	Single	N.A.	0.750	UR28-96L-155-3K7-5R-PT
○	AA1 T5R	6	UR20-24L-25-3K7-5R-PT	Single	N.A.	0.750	UR20-24L-25-3K7-5R-PT
○	AB4 T3	9	UR20-56L-140-3K7-3-PT	Single	N.A.	0.750	UR20-56L-140-3K7-3-PT

LPD Area Summary			
Label	Area	Total Watts	LPD

Calculation Summary					
Label	CalcType	Units	Avg	Max	Min
Bus Drive Aisle	Illuminance	Fc	1.79	3.2	0.3
Bus Parking	Illuminance	Fc	1.18	3.6	0.0
Crosswalk-East	Illuminance	Fc	1.15	1.3	1.0
Crosswalk-East_1	Illuminance	Fc	1.66	2.2	1.0
Crosswalk-East_2	Illuminance	Fc	2.1	1.90	1.16
North Staff Lot Walkway	Illuminance	Fc	0.95	1.7	0.4
STAFF PARKING LOT	Illuminance	Fc	1.01	2.6	0.0
Van Drive Aisle	Illuminance	Fc	1.07	2.3	0.0
Van Parking	Illuminance	Fc	0.73	2.76	0.00
Walkways @ Facility East	Illuminance	Fc	1.43	2.7	0.4
zed	Illuminance	Fc	0.01	1.14	0.00
zedd	Illuminance	Fc	0.04	1.49	0.00


JUNIPER AVENUE



PROPOSED COMPROMISE SCHEME
 Site IsoFootcandle Plot of Lighting Performance
 with Vehicles

West Valley Transportation
 Parking Area

EXHIBIT E

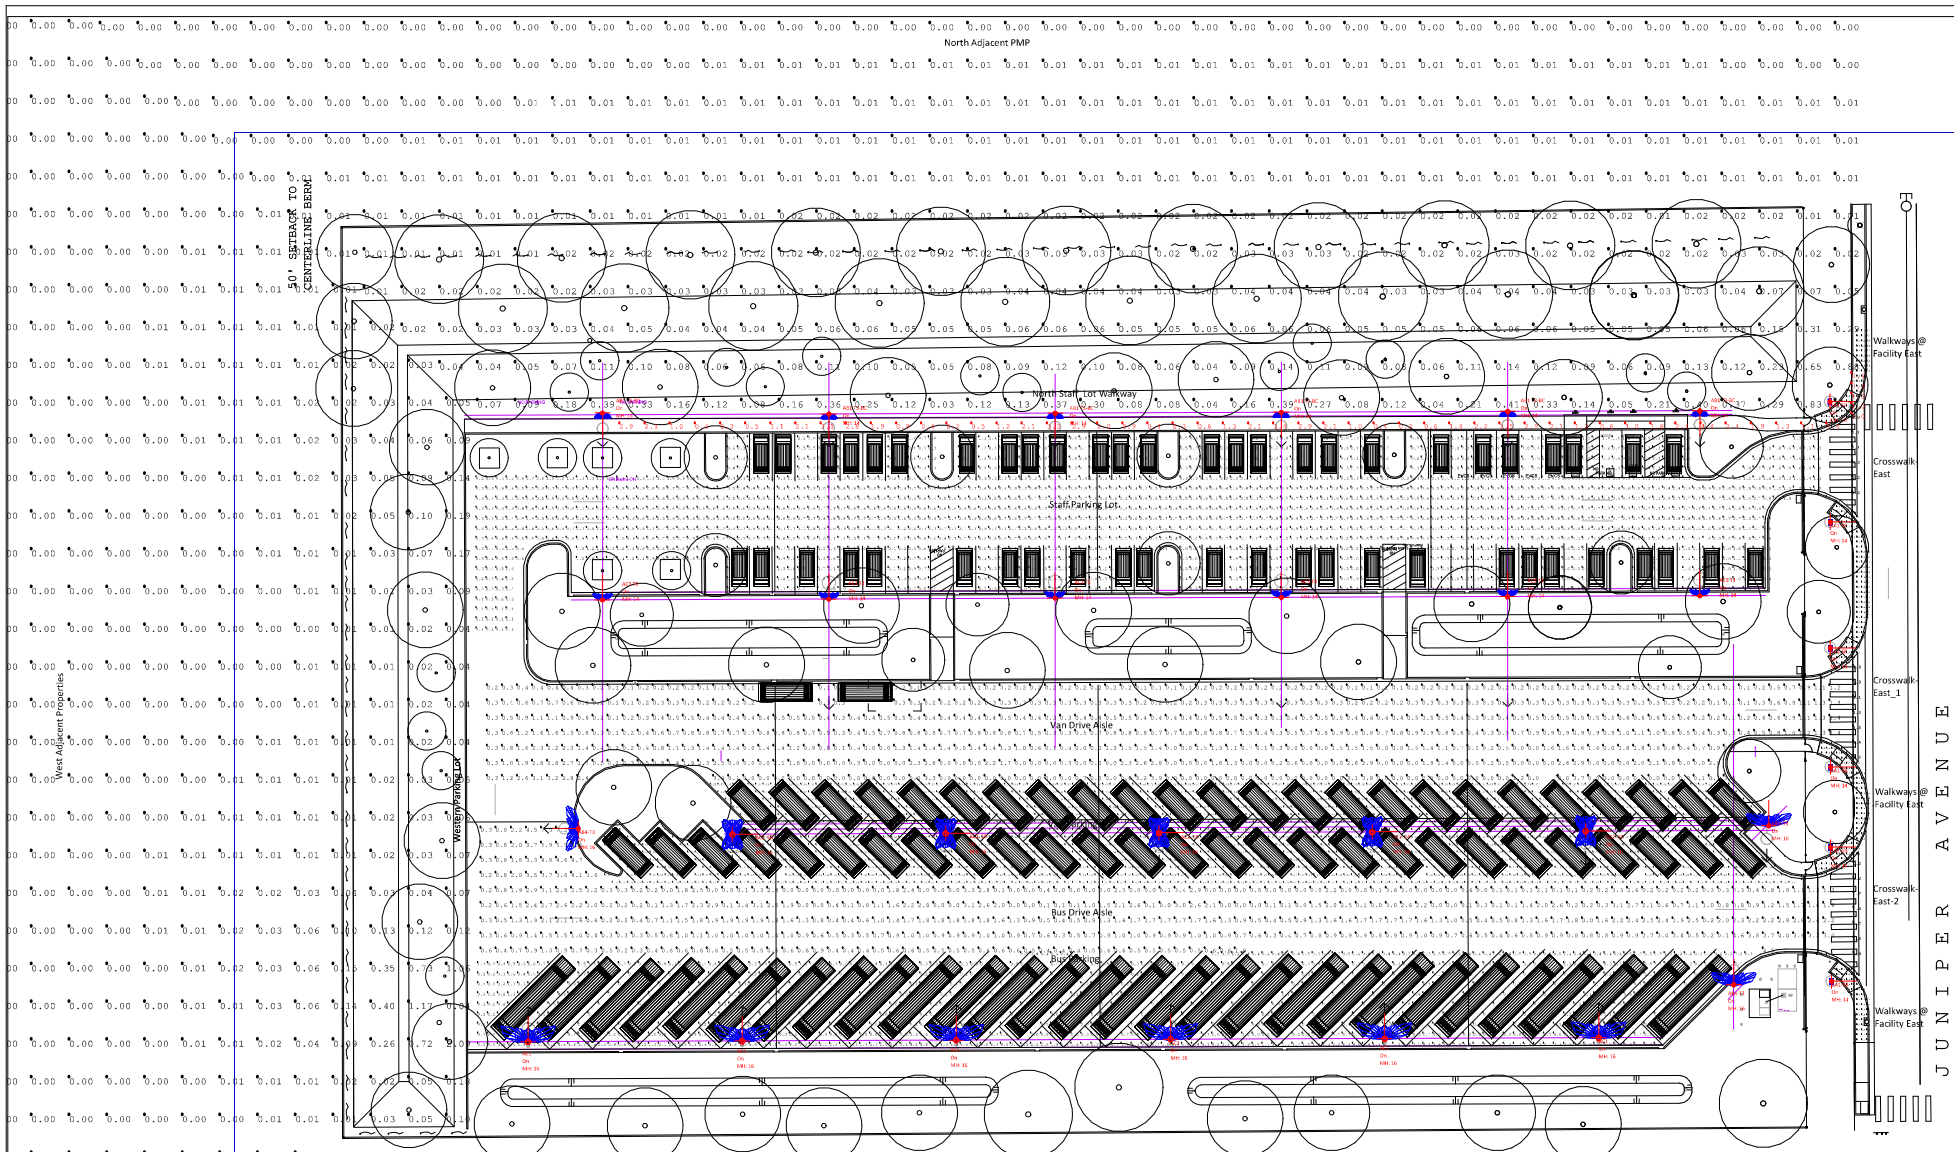

Luminaire Schedule						
Symbol	Tag	Qty	Label	Arrangement	Total Lamp Lumens	LLF
⊙	AC1	6	UR28-96L-155-3K7-3-PT	Single	N.A.	0.750
⊙	AC2 SR	5	UR28-96L-155-3K7-5R-PT	Single	N.A.	0.750
⊙	AC3 T3	6	UR20-24L-65-3K7-3-PT	Single	N.A.	0.750
⊙	AB1 T3-BC	6	UR20-56L-75-3K7-3-BC-PT	Single	N.A.	0.750
⊙	AA1-SR	6	UR20-24L-25-3K7-5R-PT 1	Single	N.A.	0.750
⊙	AB4-T3	3	UR20-56L-140-3K7-3-PT	Single	N.A.	0.750

LPD Area Summary			
Label	Area	Total Watts	LPD

Calculation Summary					
Label	CalcType	Units	Avg	Max	Min
Bus Drive Aisle	Illuminance	Fc	1.19	7.2	0.0
Bus Parking	Illuminance	Fc	1.49	10.7	0.0
Crosswalk-East	Illuminance	Fc	1.15	1.3	1.0
Crosswalk-East 1	Illuminance	Fc	1.33	2.2	1.0
Crosswalk-East 2	Illuminance	Fc	1.50	1.9	1.2
Curved Walkways East roadway	Illuminance	Fc	1.44	3.8	0.4
North Adjacent PMP	Illuminance	Fc	0.02	1.17	0.00
North Staff Lot Walkway	Illuminance	Fc	1.56	4.4	0.2
STAFF PARKING LOT	Illuminance	Fc	0.76	4.8	0.0
Van Drive Aisle	Illuminance	Fc	0.59	3.9	0.0
Van Parking	Illuminance	Fc	0.84	7.01	0.00
Walkways @ Facility East	Illuminance	Fc	1.43	3.8	0.4
Walkways East roadway	Illuminance	Fc	1.15	1.3	1.0
Walkways East roadway_1	Illuminance	Fc	1.33	2.2	1.0
Walkways East roadway_2	Illuminance	Fc	1.50	1.9	1.2
West Adjacent Properties	Illuminance	Fc	0.02	2.09	0.00

EXHIBIT E